


- NOTES:
1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL REGULATIONS.
  2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
  3. ALL DIMENSIONS ARE IN MILLIMETERS [INCHES].
  4. NET WEIGHT OF UNIT IS 161.36kg [355 lb].
  5. CABLE ENTRY IS TOP OR BOTTOM OF THE UNIT.
  6. FRONT AND REAR SERVICE ACCESS REQUIRED.
  7. AIR FLOW AND SERVICE REQUIREMENTS, AS WELL AS MINIMUM CLEARANCE TO FIRE SUPPRESSION SYSTEMS SHOULD BE CONSIDERED WHEN LOCATING THE ENCLOSURE.


THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE:	NetShelter SX 42U 750mm WIDE X 1200mm DEEP ENCLOSURE WITH SIDES GENERAL ARRANGEMENT	DWG NO:	AR3350	REV:	5
DRAWN BY:	JAYAPRAKASH	15-JUN-17	ENGINEER:	JIE ZHU	15-JUN-17
PROJECT:	SUBMITTAL DRAWINGS	SHEET 1 OF 3	APPROVED BY:	GREG IVEY	15-JUN-17
					FIRST ANGLE PJECTION

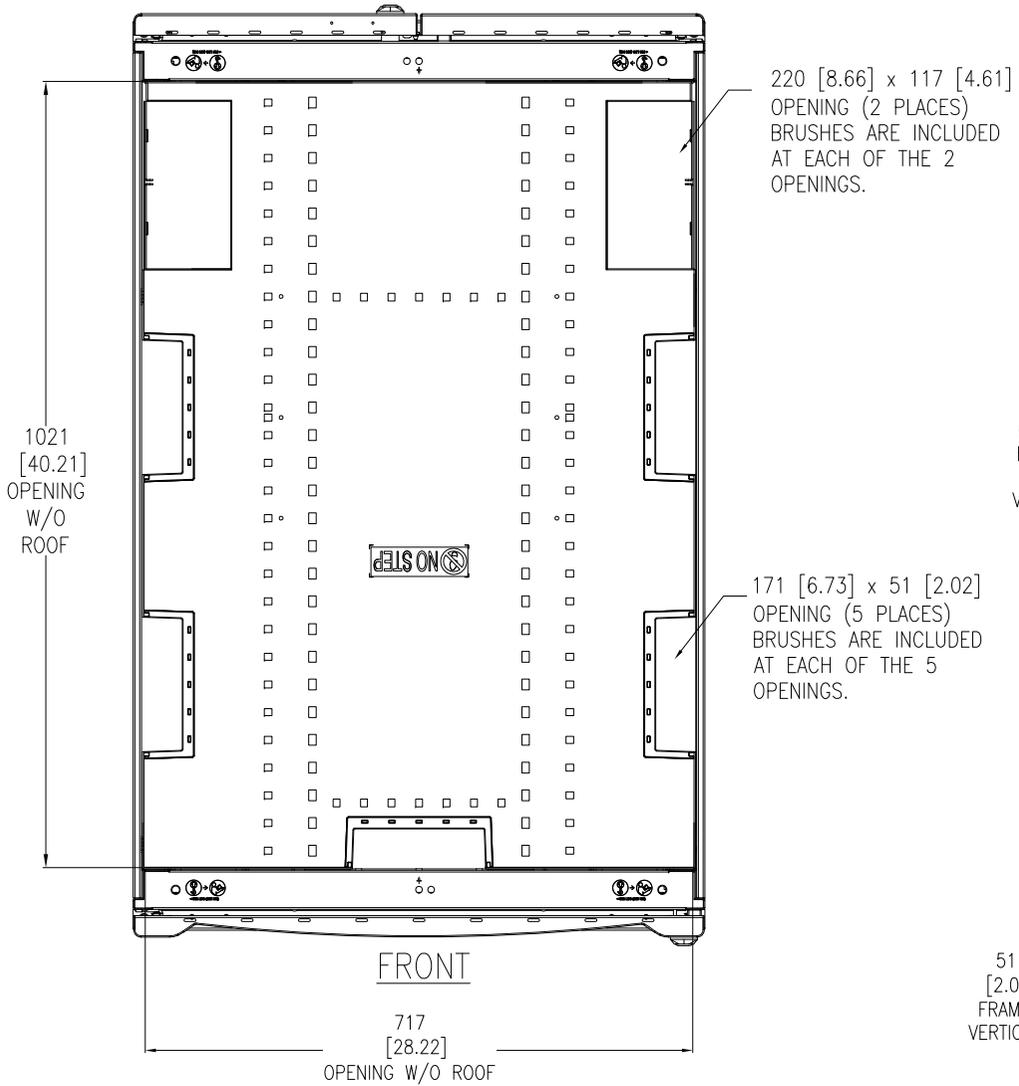

TOP VIEW  
CABLE OPENINGS  
(COVERS REMOVED)

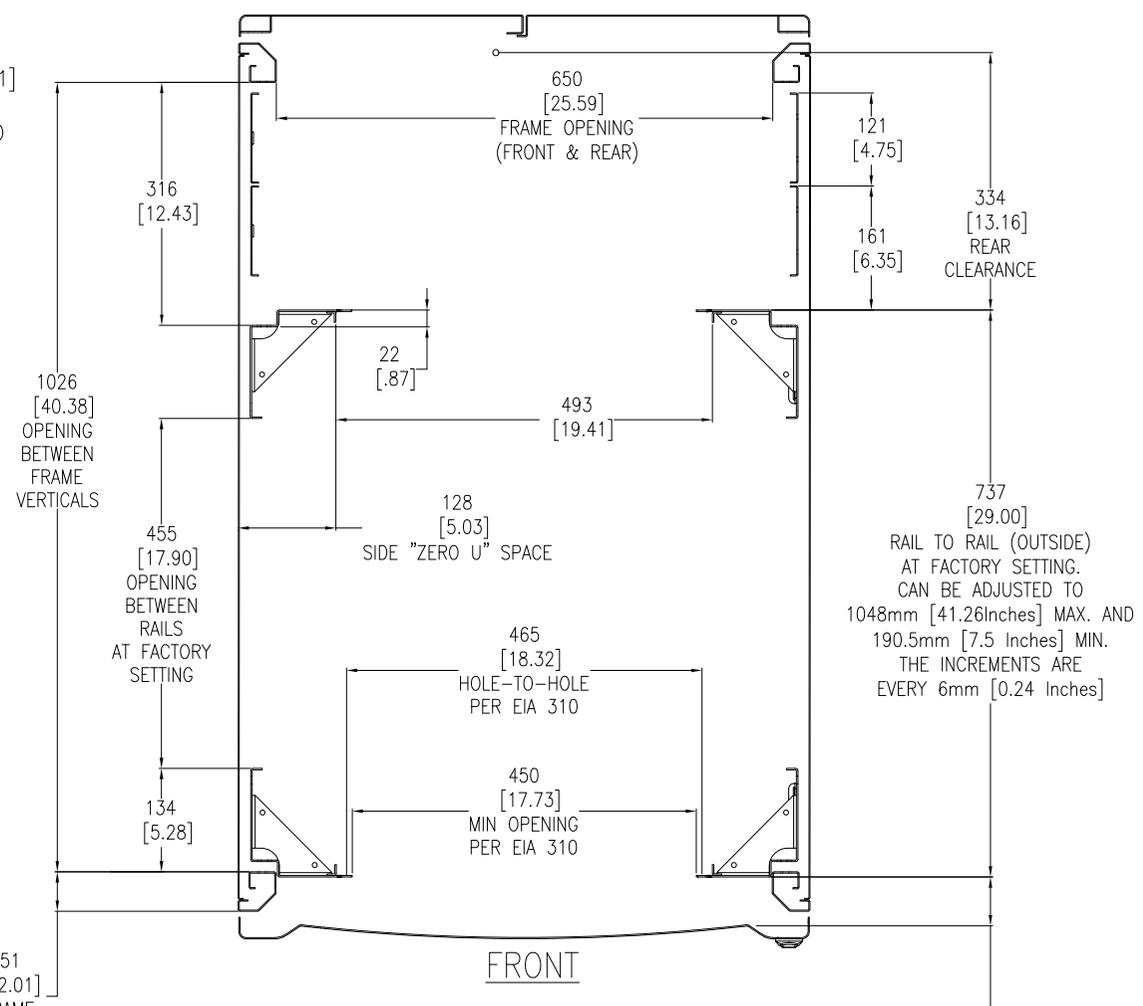

SECTION B-B  
STANDARD POSITIONS FOR  
MOUNTING RAILS AND  
THEIR ADJUSTABILITY  
(LOOKING DOWN)


- NOTES:
1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL REGULATIONS.
  2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
  3. ALL DIMENSIONS ARE IN MILLIMETERS [INCHES].

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE: NetShelter SX 42U  
750mm WIDE X 1200mm DEEP  
ENCLOSURE WITH SIDES  
TOP VIEW & SECTION VIEW


DWG NO:	AR3350	REV:	5
DRAWN BY:	JAYAPRAKASH	DATE:	15-JUN-17
ENGINEER:	JIE ZHU	DATE:	15-JUN-17
APPROVED BY:	GREG MEY	DATE:	15-JUN-17

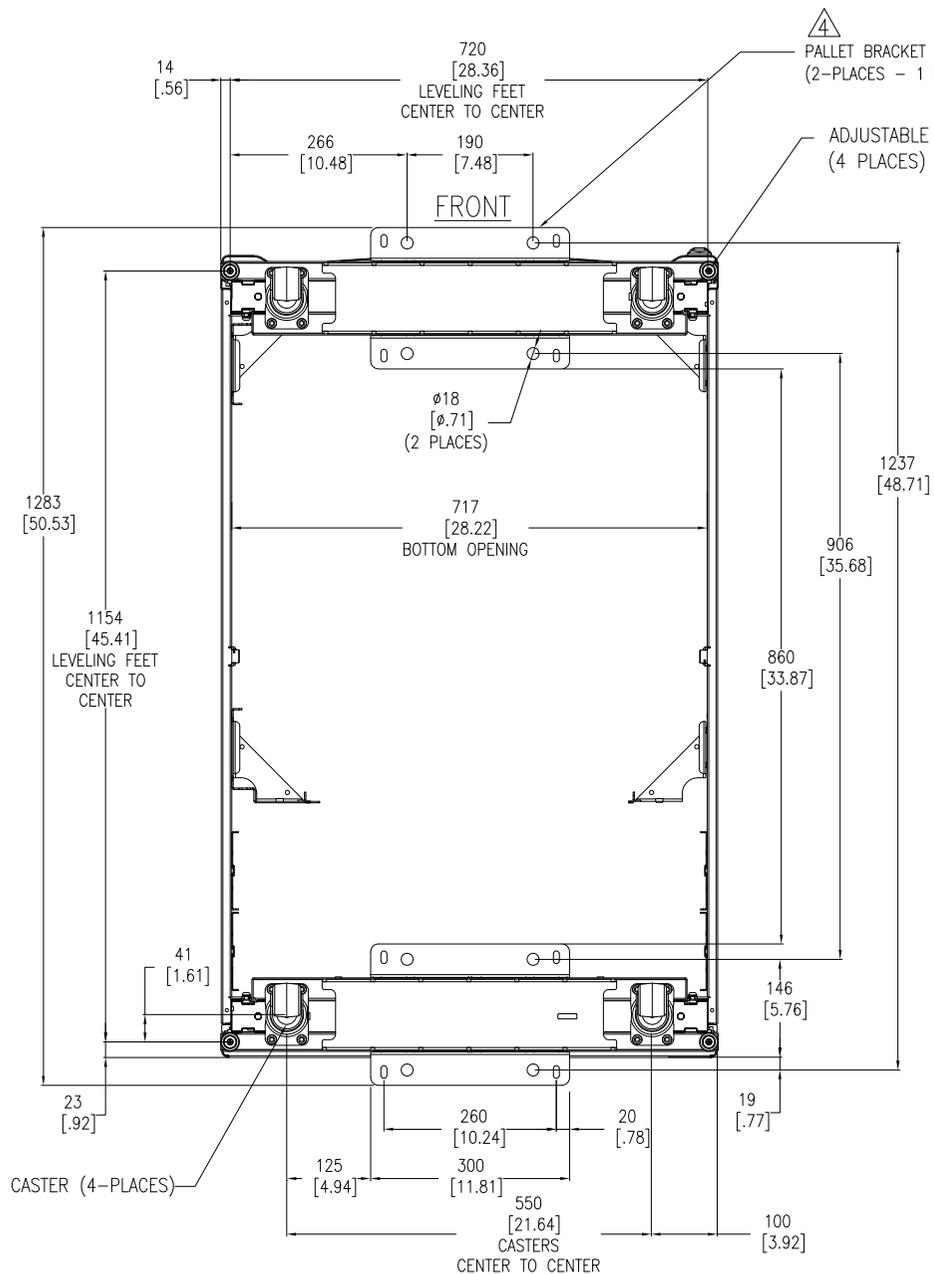

**BOTTOM VIEW**

(WITH PALLET BRACKETS, CAN BE USED FOR ANCHORING)

TOP ROOF NOT SHOWN

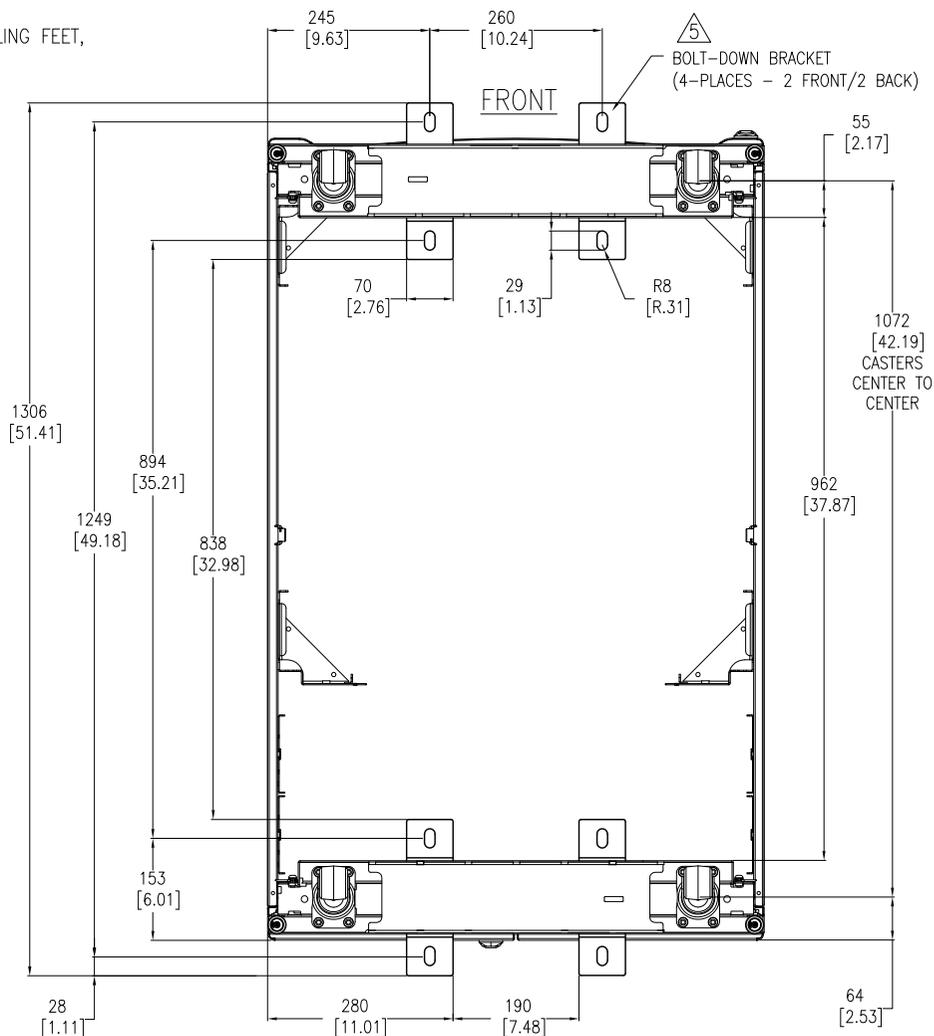

**BOTTOM VIEW**

(WITH OPTIONAL BOLT-DOWN BRACKETS FOR ANCHORING)

TOP ROOF NOT SHOWN

- NOTES:**
1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL REGULATIONS.
  2. REFER TO PRODUCT DOCUMENTATION FOR ADDITIONAL DETAILS PRIOR TO INSTALLATION AND SITE PREPARATION WORK.
  3. ALL DIMENSIONS ARE IN MILLIMETERS [INCHES].
- △4. ANCHORING CAN BE INSTALLED EITHER INSIDE OR OUTSIDE THE NetShelter WITH ONE AT FRONT AND ONE IN BACK.
- △5. BOLT-DOWN KIT (SKU# AR7701) IS OPTIONAL AND HAS TO BE ORDERED SEPARATELY.

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE.



TITLE: NetShelter SX 42U  
750mm WIDE X 1200mm DEEP  
ENCLOSURE WITH SIDES  
BOTTOM VIEWS

PROJECT: SUBMITTAL DRAWINGS SHEET 3 OF 3

DWG NO: AR3350

REV: 5

DRAWN BY: JAYAPRAKASH 15-JUN-17

ENGINEER: JIE ZHU 15-JUN-17

APPROVED BY: GREG IVEY 15-JUN-17

FIRST ANGLE PROJECTION