DATASHEET - NZMB1-A80



Circuit-breaker, 3p, 80A

NZMB1-A80 259078

0004358703

Powering Business Worldwide"

EL-Nummer (Norway)

Part no.

Catalog No.


Similar to illustration

Delivery program

| Product range | | | Circuit-breaker |
|---|-----------------------------------|----|-----------------------------|
| Protective function | | | System and cable protection |
| Standard/Approval | | | IEC |
| Installation type | | | Fixed |
| Release system | | | Thermomagnetic release |
| Construction size | | | NZM1 |
| Number of poles | | | 3 pole |
| Standard equipment | | | Box terminal |
| Switching capacity | | | |
| 400/415 V 50 Hz | l _{cu} | kA | 25 |
| Rated current = rated uninterrupted current | | | |
| Rated current = rated uninterrupted current | $I_n = I_u$ | А | 80 |
| Setting range | | | |
| Overload trip | | | |
| द | l _r | A | 63 - 80 |
| Short-circuit releases | | | |
| Non-delayed | l _i = l _n x | | 6 - 10 |
| Short-circuit releases | l _{rm} | A | 480 - 800 |

Technical data

| General | | | |
|---|----|----|--|
| Standards | | | IEC/EN 60947 |
| Protection against direct contact | | | Finger and back of hand proof to VDE 0106 Part 100 |
| Climatic proofing | | | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | | |
| Ambient temperature, storage | ٩(| С | - 40 - + 70 |
| Operation | ٥(| С | -25 - +70 |
| Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27 | g | | 20 (half-sinusoidal shock 20 ms) |
| Safe isolation to EN 61140 | | | |
| Between auxiliary contacts and main contacts | V | AC | 500 |
| between the auxiliary contacts | V | AC | 300 |
| Mounting position | | | Vertical and 90° in all directions |

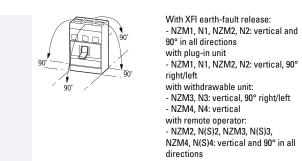

| | | | directions |
|---|---------------------------------|-------|---|
| Direction of incoming supply | | | as required |
| Degree of protection | | | |
| Device | | | In the operating controls area: IP20 (basic degree of protection) |
| Enclosures | | | With insulating surround: IP40 |
| Terminations | | | With door coupling rotary handle: IP66 Tunnel terminal: IP10 |
| | | | Phase isolator and strip terminal: IP00 |
| Other technical data (sheet catalogue) | | | Temperature dependency, Derating |
| Circuit-breakers | 1 1 | ٨ | 20 |
| Rated current = rated uninterrupted current | I _n = I _u | A | 80 |
| Rated surge voltage invariability | U _{imp} | | |
| Main contacts | | V | 6000 |
| Auxiliary contacts | | V | 6000 |
| Rated operational voltage | U _e | V AC | 440 |
| Overvoltage category/pollution degree | | | III/3 |
| Rated insulation voltage | Ui | V | 690 |
| Use in unearthed supply systems | | V | ≦ 440 |
| Switching capacity | | | |
| Rated short-circuit making capacity | I _{cm} | | |
| 240 V | I _{cm} | kA | 63 |
| 400/415 V | I _{cm} | kA | 53 |
| 440 V 50/60 Hz | I _{cm} | kA | 53 |
| Rated short-circuit breaking capacity I _{cn} | I _{cn} | | |
| Icu to IEC/EN 60947 test cycle O-t-CO | lcu | kA | |
| 240 V 50/60 Hz | I _{cu} | kA | 30 |
| 400/415 V 50/60 Hz | | kA | 25 |
| | l _{cu} | | |
| 440 V 50/60 Hz | I _{cu} | kA | 25 |
| Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0 | lcs | kA | |
| 240 V 50/60 Hz | I _{cs} | kA | 30 |
| 400/415 V 50/60 Hz | I _{cs} | kA | 25 |
| 440 V 50/60 Hz | I _{cs} | kA | 18.5 |
| | | | Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker. |
| Utilization category to IEC/EN 60947-2 | | | Α |
| Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release) | Operations | | 20000 |
| Lifespan, electrical | | | |
| AC-1 | | | |
| 400 V 50/60 Hz | Operations | | 7500 |
| 415 V 50/60 Hz | Operations | | 7500 |
| Max. operating frequency | | Ops/h | 120 |
| Total break time at short-circuit | | ms | < 10 |
| Terminal capacity | | | |
| Standard equipment | | | Box terminal |
| | | | Screw connection |
| Optional accessories | | | Tunnel terminal connection on rear |
| | | | Tunnel terminal |
| Optional accessories Round copper conductor Box terminal | | | Tunnel terminal |

| | | | 2 x (6 - 16) |
|---|------|-----------------|--|
| Stranded | | mm ² | 1 x (10 - 70) ³⁾ 2 x (6-25) |
| | | | $^{3)}$ Up to 95 $\rm mm^2$ can be connected depending on the cable manufacturer. |
| Tunnel terminal | | | |
| Solid | | mm ² | 1 x 16 |
| Stranded | | | |
| 1-hole | | mm ² | 1 x (25 - 95) |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Solid | | mm ² | 1 x (10 - 16) 2 x (6 - 16) |
| Stranded | | mm ² | 1 x (10 - 70) ³⁾ 2 x 25 |
| | | | $^{3)}$ Up to 95 $\mathrm{mm^2}\mathrm{can}$ be connected depending on the cable manufacturer. |
| Al circular conductor | | | |
| Tunnel terminal | | | |
| Solid | | mm ² | 1 x 16 |
| Stranded | | | |
| Stranded | | mm ² | 1 x (25 - 95) |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Solid | | mm ² | 1 x (10 - 16) 2 x (10 - 16) |
| Stranded | | mm ² | 1 x (25 - 35) 2 x (25 - 35) |
| Cu strip (number of segments x width x segment thickness) | | | |
| Box terminal | | | |
| | min. | mm | 2 x 9 x 0.8 |
| | max. | mm | 9 x 9 x 0.8 |
| Copper busbar (width x thickness) | mm | | |
| Bolt terminal and rear-side connection | | | |
| Screw connection | | | M6 |
| Direct on the switch | | | |
| | min. | mm | 12 x 5 |
| | max. | mm | 16 x 5 |
| Control cables | | | 1(0.750.5) |
| | | mm ² | 1 x (0.75 - 2.5) 2 x (0.75 - 1.5) |

Design verification as per IEC/EN 61439

| Technical data for design verification | | | |
|--|------------------|----|--|
| Rated operational current for specified heat dissipation | I _n | А | 80 |
| Equipment heat dissipation, current-dependent | P _{vid} | W | 16.32 |
| Operating ambient temperature min. | | °C | -25 |
| Operating ambient temperature max. | | °C | 70 |
| IEC/EN 61439 design verification | | | |
| 10.2 Strength of materials and parts | | | |
| 10.2.2 Corrosion resistance | | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | | Meets the product standard's requirements. |


| 10.3 Degree of protection of ASSEMBLIES | Does not apply, since the entire switchgear needs to be evaluated. |
|--|--|
| 10.4 Clearances and creepage distances | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | Is the panel builder's responsibility. |
| 10.9 Insulation properties | |
| 10.9.2 Power-frequency electric strength | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | Is the panel builder's responsibility. |
| 10.10 Temperature rise | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.12 Electromagnetic compatibility | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.13 Mechanical function | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

| А | 80 |
|----|--|
| V | 440 - 440 |
| kA | 25 |
| А | 63 - 80 |
| А | 0 - 0 |
| А | 480 - 800 |
| | No |
| | Frame clamp |
| | Built-in device fixed built-in technique |
| | No |
| | Yes |
| | 0 |
| | 0 |
| | 0 |
| | No |
| | No |
| | 3 |
| | Front side |
| | Rocker lever |
| | Yes |
| | No |
| | No |
| | IP20 |
| | V kA A A |

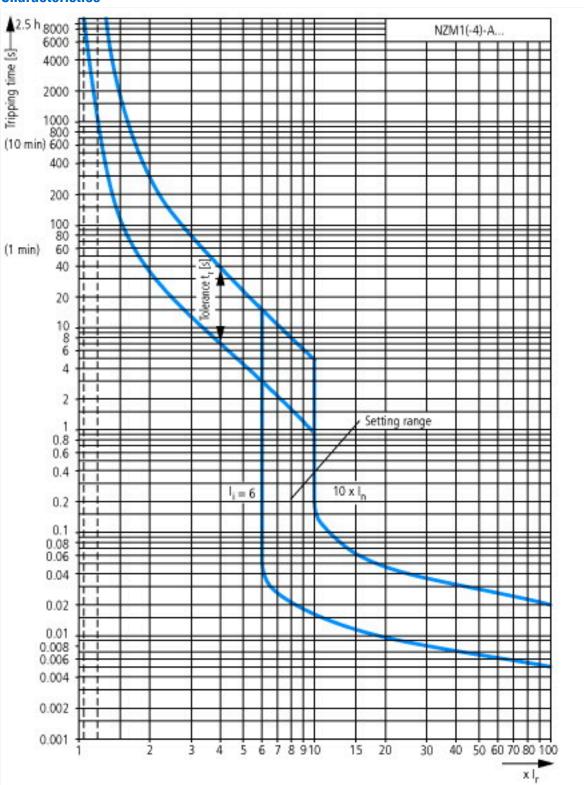



Characteristics

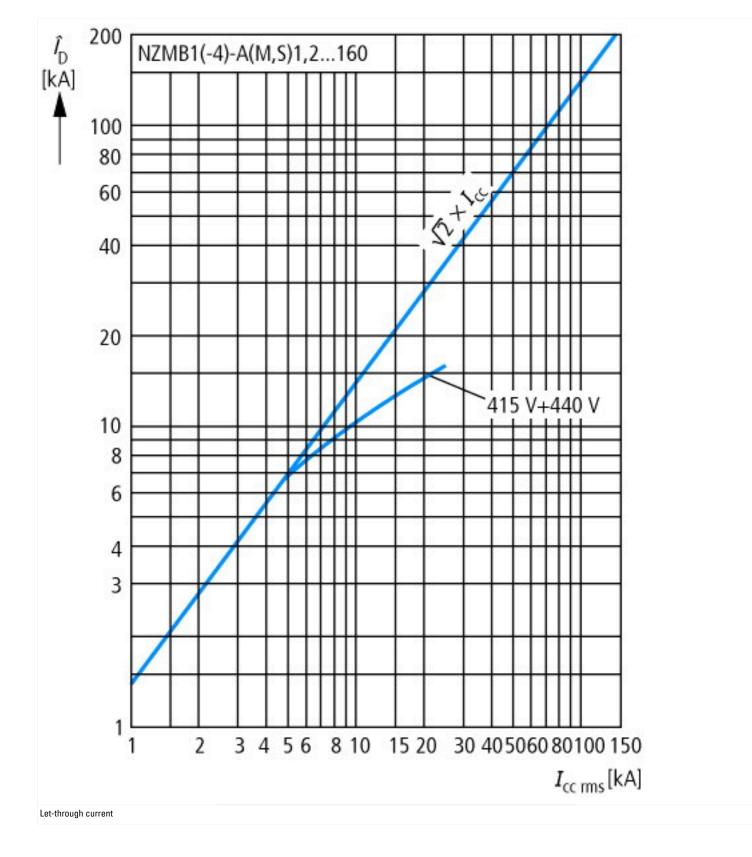

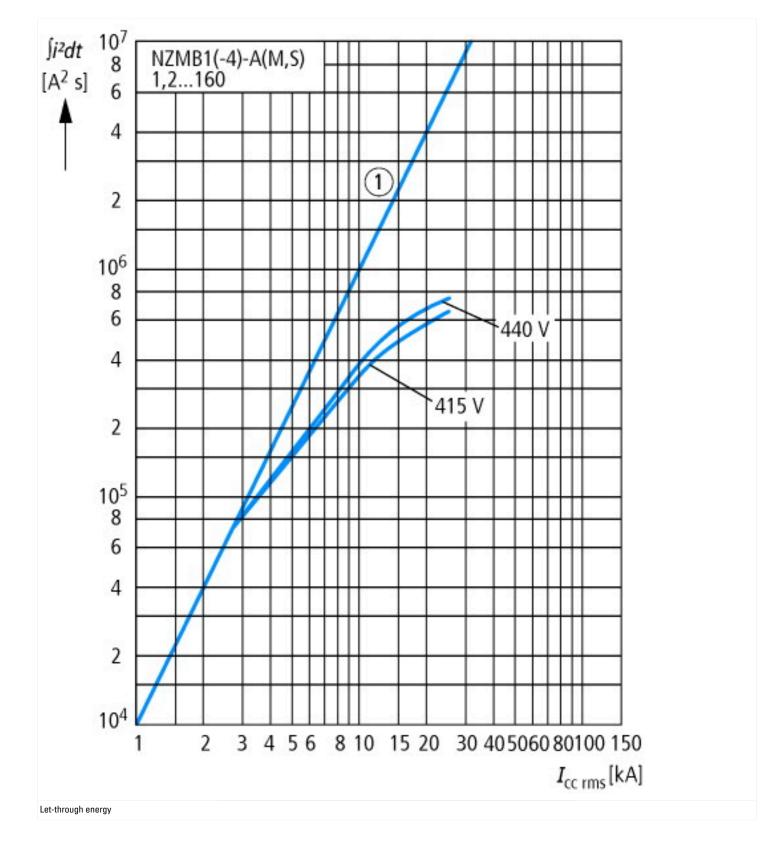



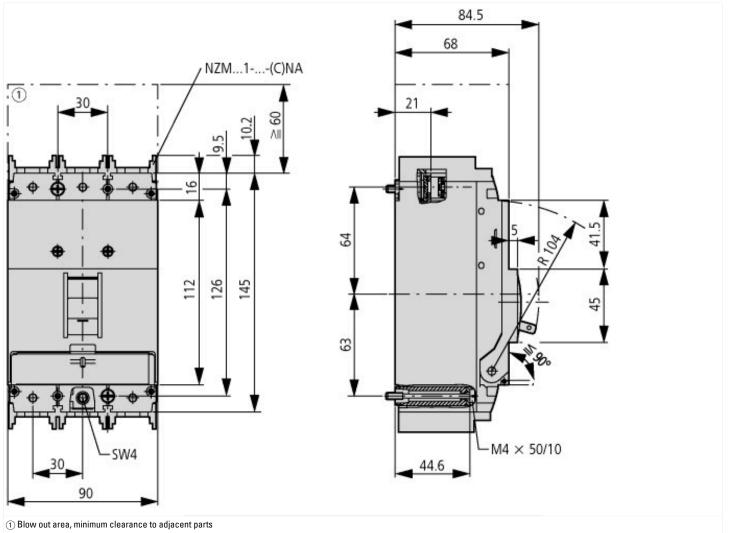

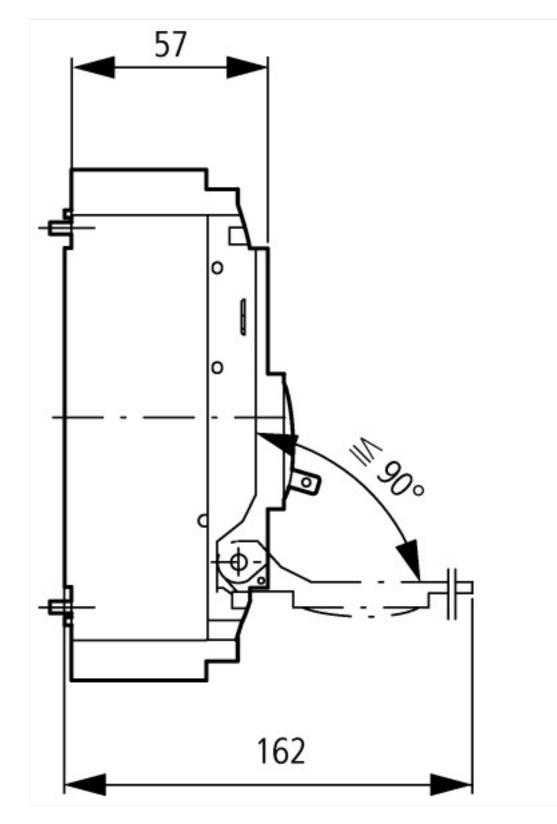

Additional product information (links)

| IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector | | | |
|--|--|--|--|
| IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector | ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01203004Z2015_11.pdf | | |
| Temperature dependency, Derating | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172 | | |
| CurveSelect characteristics program | http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm the standard stand | | |
| additional technical information for NZM power switch | ftp://ftp.moeller.net/DOCUMENTATION/PDF/nzm_technic_de_en.pdf | | |