DATASHEET - NZMB2-A160



Circuit-breaker, 3p, 160A

NZMB2-A160 Part no. Catalog No. 259088

EL-Nummer (Norway)

0004315534



Delivery program			
Product range			Circuit-breaker
Protective function			System and cable protection
Standard/Approval			IEC
Installation type			Fixed
Release system			Thermomagnetic release
Construction size			NZM2
Number of poles			3 pole
Standard equipment			Screw connection
Switching capacity			
400/415 V 50 Hz	I _{cu}	kA	25
Rated current = rated uninterrupted current			
Rated current = rated uninterrupted current	$I_n = I_u$	Α	160
Setting range			
Overload trip			
中	I _r	A	125 - 160
Short-circuit releases			
Non-delayed	$I_i = I_n x \dots$		6 - 10
Short-circuit releases	I _{rm}	A	960 - 1600

Technical data

	_	_	_	_	_1
- 15	ρ	п	ρ	п	ЯI

General		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70
Operation	°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27	g	20 (half-sinusoidal shock 20 ms)
Safe isolation to EN 61140		
Between auxiliary contacts and main contacts	V AC	500
between the auxiliary contacts	V AC	300
Weight	kg	2.345
Mounting position		Vertical and 90° in all directions With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit:

			- NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required
Degree of protection			
Device			In the operating controls area: IP20 (basic degree of protection)
Enclosures Terminations			With insulating surround: IP40 With door coupling rotary handle: IP66 Tunnel terminal: IP10
			Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)			Temperature dependency, Derating
Circuit-breakers		Δ.	100
Rated current = rated uninterrupted current	$I_n = I_u$	A	160
Rated surge voltage invariability	U _{imp}		
Main contacts		V	8000
Auxiliary contacts		V	6000
Rated operational voltage	U _e	V AC	440
Overvoltage category/pollution degree			111/3
Rated insulation voltage	Ui	V	690
Use in unearthed supply systems		V	≦ 440
Switching capacity			
Rated short-circuit making capacity	I _{cm}		
240 V	I _{cm}	kA	63
400/415 V	I _{cm}	kA	53
440 V 50/60 Hz	I _{cm}	kA	53
Rated short-circuit breaking capacity I _{cn}	I _{cn}		
Icu to IEC/EN 60947 test cycle 0-t-C0	Icu	kA	
240 V 50/60 Hz	I _{cu}	kA	30
400/415 V 50/60 Hz	I _{cu}	kA	25
440 V 50/60 Hz	I _{cu}	kA	25
Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0	lcs	kA	
240 V 50/60 Hz	I _{cs}	kA	30
400/415 V 50/60 Hz	I _{cs}	kA	25
440 V 50/60 Hz	I _{cs}	kA	18.5
740 V 30/00 Hz	ics	NA.	Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
Rated short-time withstand current			
t = 1 s	I _{cw}	kA	85
Utilization category to IEC/EN 60947-2			A
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		20000
Lifespan, electrical			
AC-1			
400 V 50/60 Hz	Operations		10000
415 V 50/60 Hz	Operations		7500
Max. operating frequency		Ops/h	120
Total break time at short-circuit		ms	<10
Terminal capacity			
Standard equipment			Screw connection
Optional accessories			Box terminal Tunnel terminal connection on rear
Round copper conductor			
Box terminal			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm^2	1 x (25 - 185)

			2 x (25 - 70)
Tunnel terminal			2 \(\lambda(23 - 10)\)
Solid		mm ²	1 x 16
		mm	
Stranded		2	1(05105)
1-hole		mm ²	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (6 - 16)
Stranded		mm ²	1 x (25 - 185) 2 x (25 - 70)
Al circular conductor			
Tunnel terminal			
Solid		mm^2	1 x 16
Stranded			
Stranded		mm ²	1 x (25 - 185)
Bolt terminal and rear-side connection			
Direct on the switch			
Solid		mm ²	1 x (10 - 16) 2 x (10 - 16)
Stranded		mm ²	1 x (25 - 50) 2 x (25 - 50)
Cu strip (number of segments x width x segment thickness)			
Box terminal			
	min.	mm	2 x 9 x 0.8
	max.	mm	10 x 16 x 0.8 (2x) 8 x 15.5 x 0,8
Bolt terminal and rear-side connection			
Flat copper strip, with holes	min.	mm	2 x 16 x 0.8
Flat copper strip, with holes	max.	mm	10 x 24 x 0.8
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M8
Direct on the switch			
	min.	mm	16 x 5
	max.	mm	24 x 8
Control cables			
		mm ²	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

Design verification as per IEC/EN 61439

2001g.: 1011110u.iion uo poi 120,211 01 100			
Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	160
Equipment heat dissipation, current-dependent	P _{vid}	W	38.4
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.


10.3 Degree of protection of ASSEMBLIES	Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.


Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


Rated voltage Rated voltage Rated short-circuit breaking capacity Icu at 400 V, 50 Hz Rated short-circuit breaking capacity Icu at 400 V, 50 Hz Rated short-circuit breaking capacity Icu at 400 V, 50 Hz Rated short-circuit breaking capacity Icu at 400 V, 50 Hz Rated short-circuit breaking capacity Icu at 400 V, 50 Hz Rated short-circuit release Rated short-circuit	protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])		
Rated short-circuit breaking cepacity lcu at 400 V, 50 Hz Overload release current setting Alightment range short-term delayed short-circuit release Alightment range undelayed short-circuit release No Suitable for DIN rail (top hat rail) mounting Built-in device fixed built-in technique No No No No No No No No With switched-off indicator With switched-off indicator With under voltage release No No No No No No No No No N	Rated permanent current lu	А	160
Overload release current setting Adjustment range short-term delayed short-circuit release Adjustment range undelayed short-circuit rel	Rated voltage	V	440 - 440
Adjustment range short-term delayed short-circuit release Adjustment range undelayed short-circuit release Adjustment range short-term delayed short-t	Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	25
Adjustment range undelayed short-circuit release A 960 - 1600 Integrated earth fault protection Type of electrical connection of main circuit Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional No DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Vith switched-off indicator With switched-off indicator With under voltage release Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional A 960 - 1600 No Screw connection No Screw connection Vese connection Screw connection O O O O O O O O O O O O O O O O O O O	Overload release current setting	А	125 - 160
Integrated earth fault protection Type of electrical connection of main circuit Device construction Built-in device fixed built-in technique Suitable for DIN rail (top hat rail) mounting No DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact Number of of auxiliary contacts as change-over contact No	Adjustment range short-term delayed short-circuit release	Α	0 - 0
Type of electrical connection of main circuit Device construction Built-in device fixed built-in technique No DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact With switched-off indicator With under voltage release No Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional	Adjustment range undelayed short-circuit release	А	960 - 1600
Device construction Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact No With switched-off indicator With switched-off indicator No No No No No No No No No	Integrated earth fault protection		No
Suitable for DIN rail (top hat rail) mounting DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of poles No No No Number of poles Society of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated No Motor drive optional Society of Societ	Type of electrical connection of main circuit		Screw connection
DIN rail (top hat rail) mounting optional Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact No With switched-off indicator With under voltage release No Number of poles 3 Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional Yes Yes Motor drive optional	Device construction		Built-in device fixed built-in technique
Number of auxiliary contacts as normally closed contact Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact Number of auxiliary contacts as change-over contact No With switched-off indicator With under voltage release No No Number of poles Sales Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional O O No No No No No No No No	Suitable for DIN rail (top hat rail) mounting		No
Number of auxiliary contacts as normally open contact Number of auxiliary contacts as change-over contact No With switched-off indicator With under voltage release No No Number of poles Solution of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional O O O O O O O O O O O O O	DIN rail (top hat rail) mounting optional		Yes
Number of auxiliary contacts as change-over contact With switched-off indicator No With under voltage release No Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive integrated Motor drive optional No O O O O O O O O O O O O O	Number of auxiliary contacts as normally closed contact		0
With switched-off indicator With under voltage release No Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive optional No No No No No No No Yes	Number of auxiliary contacts as normally open contact		0
With under voltage release No Number of poles Solution of connection for main current circuit Type of control element Complete device with protection unit Motor drive optional No	Number of auxiliary contacts as change-over contact		0
Number of poles Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive optional 3 Front side Rocker lever Rocker lever Yes No Yes	With switched-off indicator		No
Position of connection for main current circuit Type of control element Complete device with protection unit Motor drive optional Front side Rocker lever Yes No Yes	With under voltage release		No
Type of control element Complete device with protection unit Motor drive optional Rocker lever Yes No Yes	Number of poles		3
Complete device with protection unit Yes Motor drive integrated Motor drive optional Yes Yes	Position of connection for main current circuit		Front side
Motor drive integrated No Yes	Type of control element		Rocker lever
Motor drive optional Yes	Complete device with protection unit		Yes
·	Motor drive integrated		No
Degree of protection (IP)	Motor drive optional		Yes
	Degree of protection (IP)		IP20

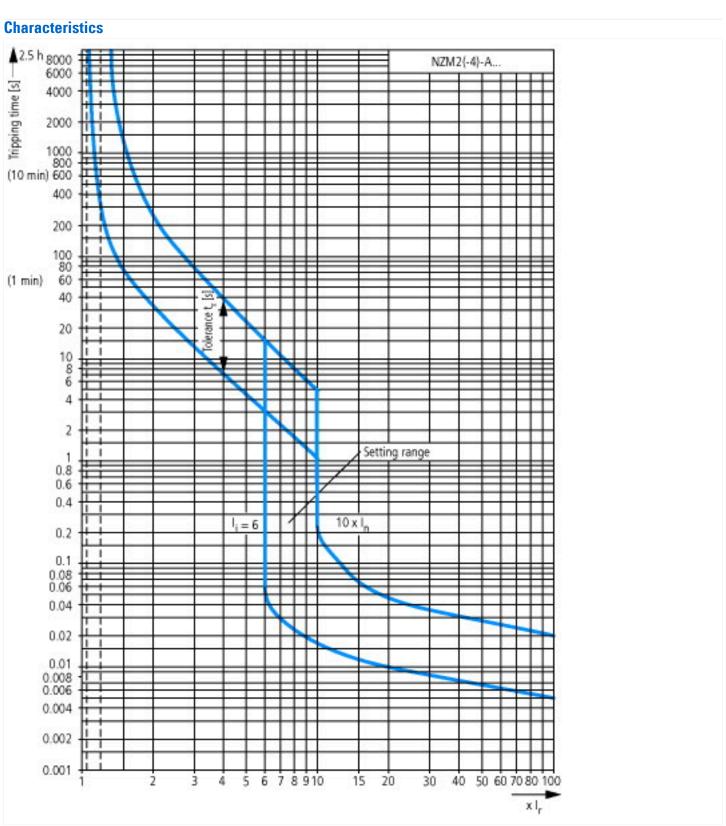

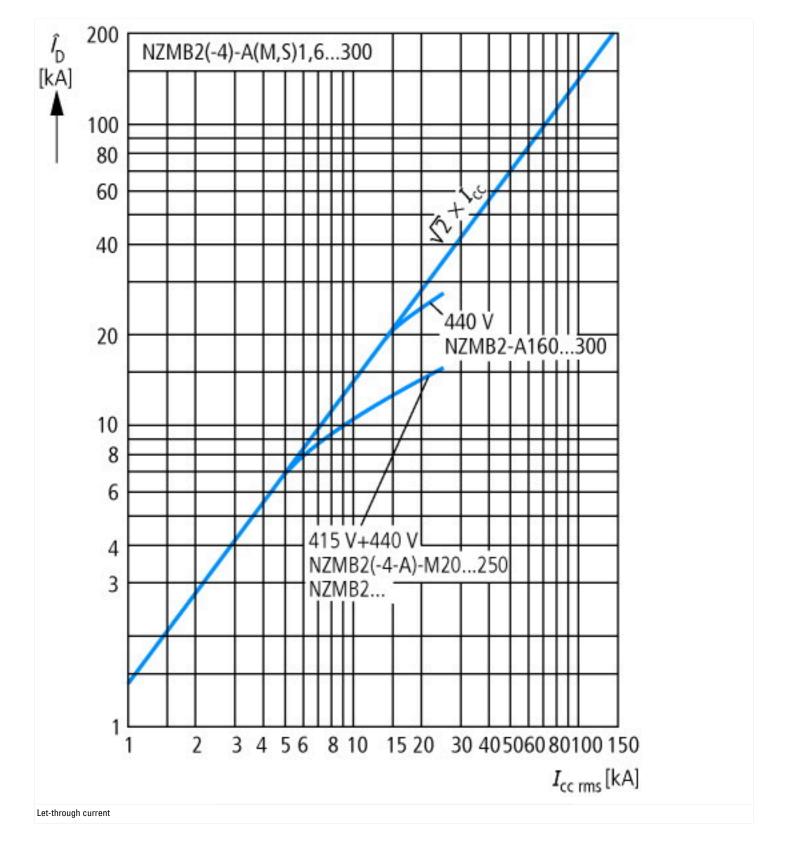


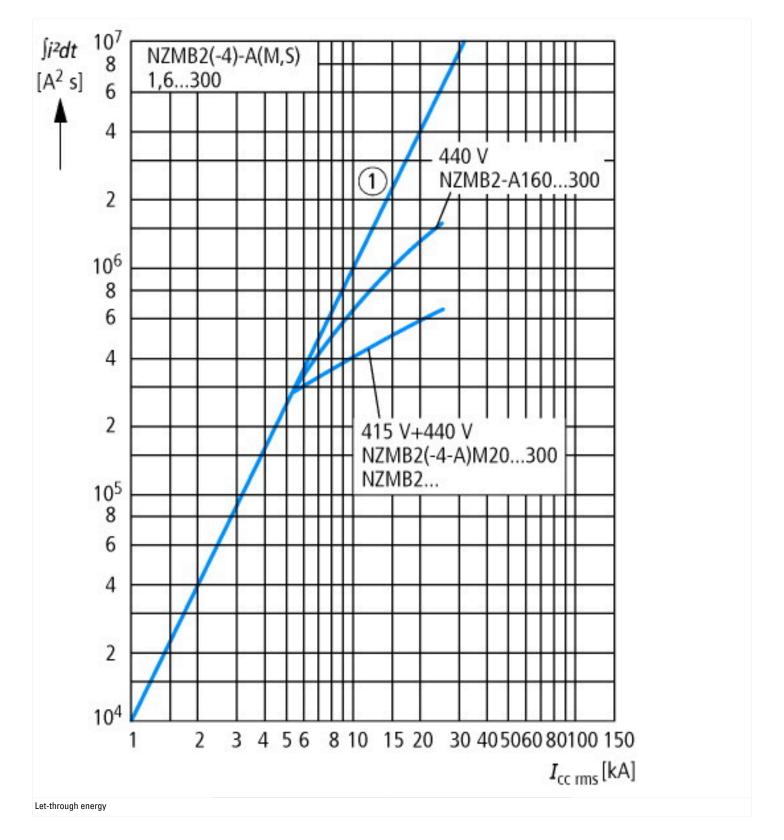

Dimensions

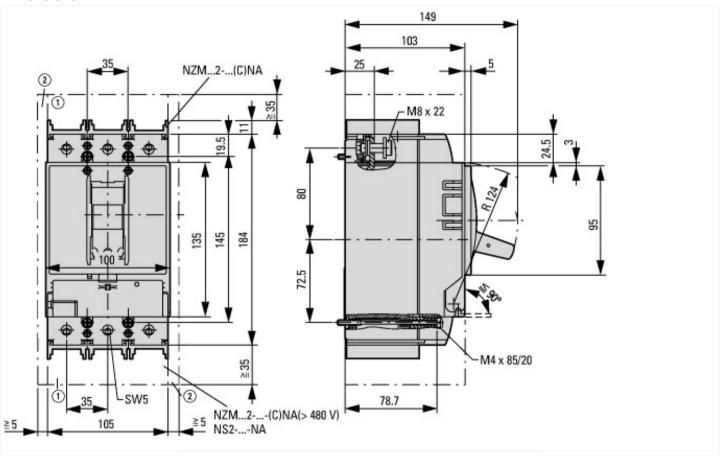

Blow out area, minimum clearance to adjacent parts
 Minimum clearance to adjacent parts

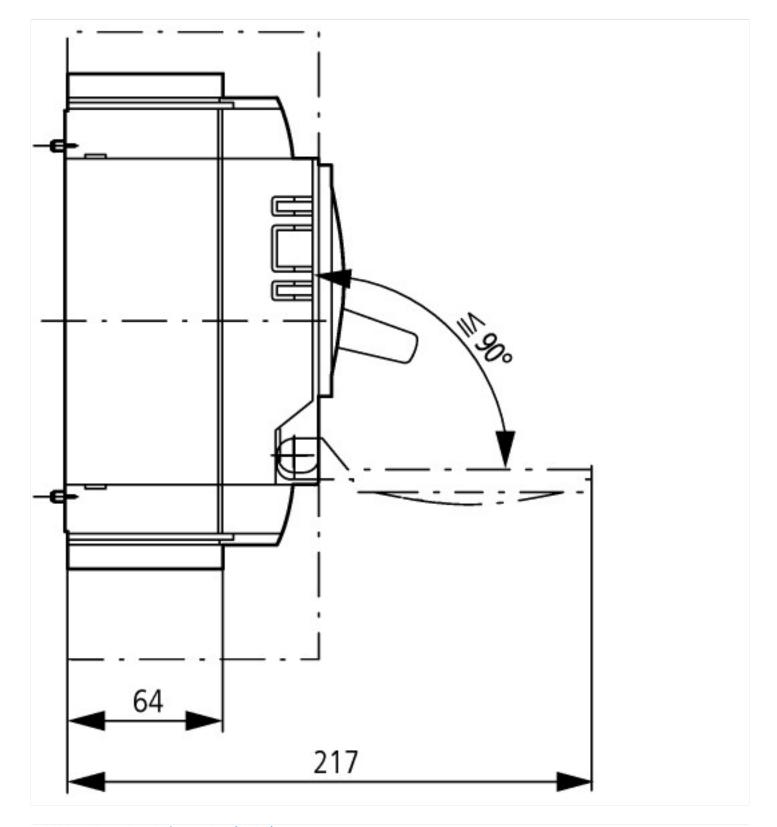

Additional product information (links)

IL01206006Z (AWA1230-1916) Circuit-Breaker, basic unit		
IL01206006Z (AWA1230-1916) Circuit-Breaker, basic unit	ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01206006Z2015_11.pdf	
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172	
CurveSelect characteristics program	http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm	
additional technical information for NZM power switch	ftp://ftp.moeller.net/DOCUMENTATION/PDF/nzm_technic_de_en.pdf	