DATASHEET - M22-I12

Surface mounting enclosure, 12 mounting locations





Part no. M22-I12 Catalog No. 222688 Alternate Catalog M22-I120 No. EL-Nummer 4355389 (Norway)

Delivery program

Basic function accessories		Surface mounting enclosure
Housing		Insulated material
		With high-grade steel screws
Number of locations	Qty.	12
Degree of Protection		IP66
Colour		
RAL Value		RAL 7035
Colour		Enclosure base anthracite
Connection to SmartWire-DT		no
For use with		12 x Ø 22.5
For use with		(Illuminated) pushbuttons (Illuminated) selector switches Key-operated pushbuttons Indicator light controlled stop/emergency-stop buttons with yellow label

Technical data

General	
Degree of Protection	IP66
Ambient temperature	
Open	°C -25 - +70
Cable entry knockouts	
Base	Quantity 2 x 32/25 x M
Sides	Quantity 2 x 20 x M 4 x 32/25

Design verification as per IEC/EN 61439

Technical data for design verification °C -25 Operating ambient temperature max. °C 70	
Operating ambient temperature may °C 70	
IEC/EN 61439 design verification	
10.2 Strength of materials and parts	
10.2.2 Corrosion resistance Meets the product standard's	requirements.
10.2.3.1 Verification of thermal stability of enclosures Meets the product standard's	requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat Meets the product standard's	requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects	requirements.
10.2.4 Resistance to ultra-violet (UV) radiation Please enquire	
10.2.5 Lifting Does not apply, since the entire	re switchgear needs to be evaluated.
10.2.6 Mechanical impact Does not apply, since the entire	re switchgear needs to be evaluated.
10.2.7 Inscriptions Meets the product standard's	requirements.
10.3 Degree of protection of ASSEMBLIES Does not apply, since the entire	re switchgear needs to be evaluated.

10.4 Clearances and creepage distances	Meets the product standard's requirements.
10.5 Protection against electric shock	Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components	Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections	Is the panel builder's responsibility.
10.8 Connections for external conductors	Is the panel builder's responsibility.
10.9 Insulation properties	
10.9.2 Power-frequency electric strength	Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage	Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material	Is the panel builder's responsibility.
10.10 Temperature rise	The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility	Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function	The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

Technical data ETIM 7.0

Low-voltage industrial components (EG000017) / Enclosure for control circuit devices (EC000200)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Command and alarm device / Housing for command and alarm devices (ecl@ss10.0.1-27-37-12-05 [AKF023014])

	12
	Surface mounting housing
	Plastic
	Other
mm	22.5
	Grey
	IP66
	4X
mm	160
mm	240
mm	125
	mm

Approvals

Product Standards	IEC/EN 60947-5; UL 508; CSA-C22.2 No. 14-05; CSA-C22.2 No. 94-91; CE marking
UL File No.	E29184
UL Category Control No.	NKCR
CSA File No.	012528
CSA Class No.	3211-03
North America Certification	UL listed, CSA certified
Degree of Protection	UL/CSA Type 3R, 4X, 12, 13

Dimensions

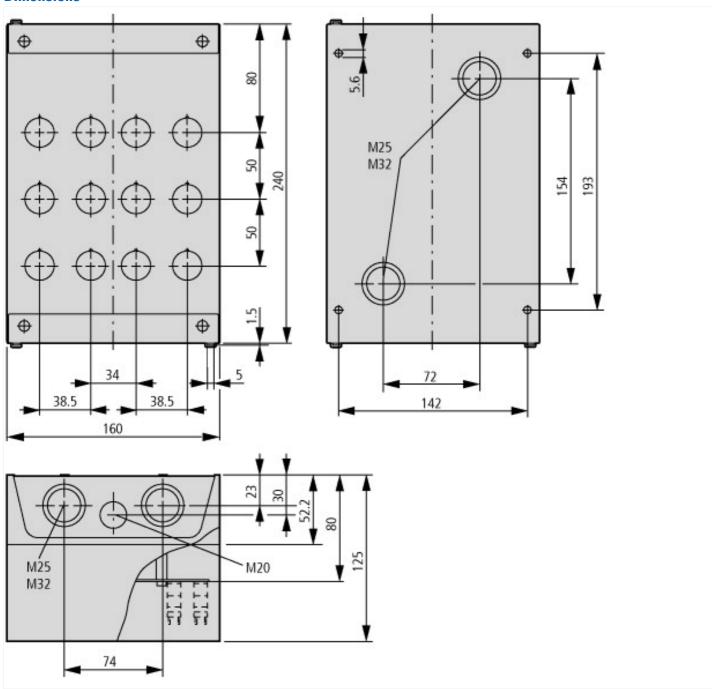

Additional product information (links)

IL04716003Z (AWA1160-1746) RMQ-Titan System

IL04716003Z (AWA1160-1746) RMQ-Titan ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL04716003Z2018_06.pdf System